


Segment Protector for Cabinet Installation

R2-SP-IC*



- 4 ... 12 outputs Ex ic (FISCO or Entity) or non-incendive (Div 2)
- Advanced fault isolation at the spur
- Segment Protector in Zone 2/Div. 2
- Instruments in Zone 2/Div. 2 or Zone 1/Div. 1
- For FOUNDATION Fieldbus H1 and PROFIBUS PA
- Advanced Diagnostics at the spur
- Power, Com, Diagnostics, and Error LEDs
- T-connector for easy installation and maintenance
- Test points for easy troubleshooting

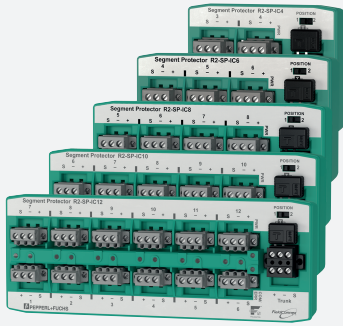


Function

The R2 Segment Protector with integrated diagnostics, a device coupler for DIN rail installation, connects 4 ... 12 instruments to the segment with intrinsic safety (Ex ic, Zone 2/Div. 2). Device connections in Zone 1/Div. 1 require additional methods of ignition protection. Short-circuit, jabber, and bounce protection isolates most fault condition types from the segment. The short-circuit limit is adjustable for maximum load with Ex ic for gas groups IIB and IIC.

The T-connector at the trunk allows for exchange of a Segment Protector with no effect on the remaining segment. The terminator is mounted at the 'T' and removed for network extensions ensuring proper termination.

Short circuit protection ensures proper operation of the segment in case of unwanted faults at the spur. Intrinsic safety at the spur enables work on devices with hot work permit. The integrated fieldbus terminator features a high-availability design.

Connection

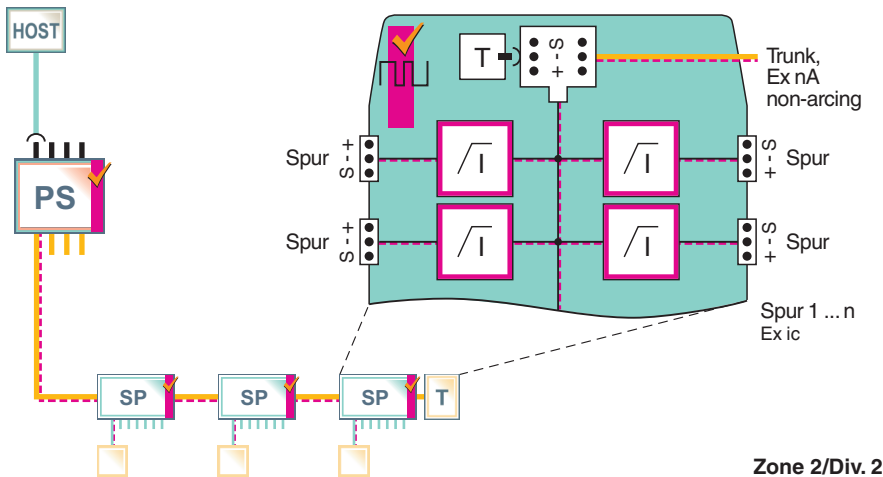

Technical Data

General specifications

Design / Mounting Cabinet installation

Fieldbus connection

Main cable (Trunk)

Rated voltage 9 ... 31 V DC
10.5 V DC minimum input voltage acc. to FF-846

Rated current max. 4.5 A

Outputs

Number of outputs see table "Technical data depending on model"

Release date: 2023-08-01 Date of issue: 2023-08-01 Filename: t158642_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

Technical Data

Number of devices per output		1
Rated voltage		max. 31 V
Rated current		max. 32 mA switch 1, position 1 max. 43 mA switch 1, position 2
Short-circuit current		46 mA switch 1, position 1 57 mA switch 1, position 2
Self current consumption		see table "Technical data depending on model"
Voltage drop main cable/outputs		max. 1.2 V
Voltage drop trunk In/Out		0 V
Terminating resistor		external type M-FT 100 Ω +/- 10 %
Surge protection		Trunk overvoltage protection if voltage exceeds typ. 39 V, max. 41 V
Indicators/operating means		
Switch		configuration of short-circuit current/rated current
LED PWR		green: Fieldbus voltage > 10 V and fieldbus terminator is deactivated
LED COM/ERR		yellow: flashing: fieldbus communication status and physical layer diagnostic status
LED SPURS		red: 2 Hz flashing in short-circuit condition
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013
Standard conformity		
Electromagnetic compatibility		
Degree of protection		NE 21:2011
Fieldbus standard		IEC 61158-2
Climatic conditions		IEC 60721
Shock resistance		EN 60068-2-27
Vibration resistance		EN 60068-2-6
Ambient conditions		
Ambient temperature		-50 ... 70 °C (-58 ... 158 °F)
Storage temperature		-50 ... 85 °C (-58 ... 185 °F)
Relative humidity		< 95 % non-condensing
Shock resistance		15 g 11 ms
Vibration resistance		1 g , 10 ... 150 Hz
Corrosion resistance		acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications		
Connection type		pluggable , screw terminal or spring terminal
Core cross section		see table 2
Housing material		Polycarbonate
Degree of protection		IP20
Mass		see table "Technical data depending on model"
Dimensions		see table "Technical data depending on model"
Mounting		DIN rail mounting
Data for application in connection with hazardous areas		
EU-type examination certificate		TÜV 12 ATEX 098651 X
Marking		Ⓜ II 3G Ex nA [ic] IIC T4 Gc Ⓜ II (3)D [Ex ic Dc] IIIC
Supply		
Maximum safe voltage	U _m	35 V
Outputs		
Voltage	U _o	32 V
Current	I _o	46 mA switch 1, position 1 65 mA switch 1, position 2
Inductance	L _o	0.125 mH switch 1, position 1 0.25 mH switch 1, position 2
Capacitance	C _o	60 nF
Directive conformity		

Release date: 2023-08-01 Date of issue: 2023-08-01 Filename: t158642_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".


Pepperl+Fuchs Group
www.pepperl-fuchs.comUSA: +1 330 486 0002
pa-info@us.pepperl-fuchs.comGermany: +49 621 776 2222
pa-info@de.pepperl-fuchs.comSingapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

Technical Data

Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 , EN 60079-11:2012 , EN 60079-15:2010
International approvals	
UL approval	E106378
Control drawing	116-0406
Approved for	Class I, Division 2, Groups A, B, C, D
IECEX approval	IECEX TUN 12.0015X
Approved for	Ex nA [ic] IIC T4 Gc [Ex ic Dc] IIIC
General information	
Supplementary information	Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Assembly

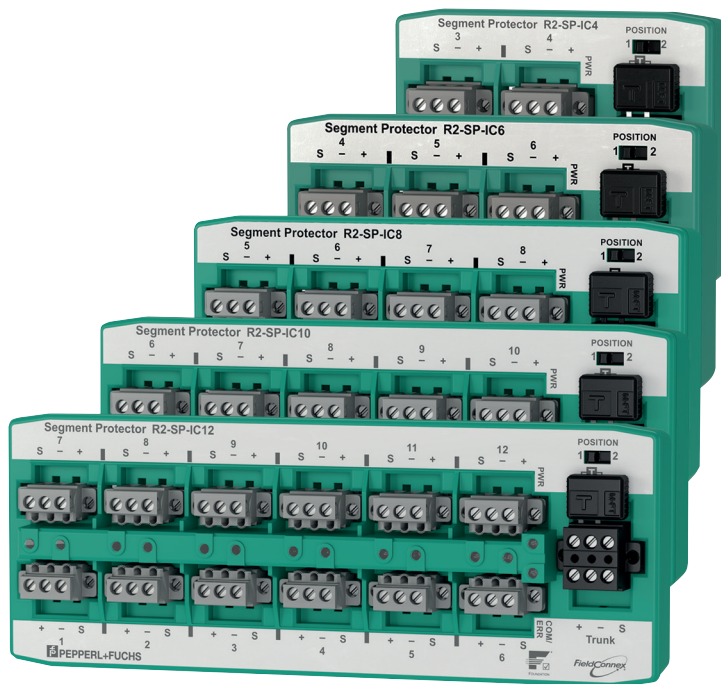

Matching System Components

	F.SP5.P** .B** .1.0.***.***.***0	Segment Protector Junction Box, Polyester (GRP)
	F.SP5.T** .***.1* .***.***.***	Segment Protector Junction Box, Brushed Stainless Steel






Accessories

	M-FT	Fieldbus terminator
	T-CON.3	T-Connector as Accessory, 3 pcs.
	TP-CON.3	Fieldbus Plug Sockets with Test Points, 4 pcs.
	TCP-LBF-IA1.36.IE*	Fieldbus Surge Protector, Field Installation on Trunk

Release date: 2023-08-01 Date of issue: 2023-08-01 Filename: t158642_eng.pdf


Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Accessories

	TCP-LBF-IA1.36.IE.0	Surge Protector for Plugging onto the Trunk, Ex ia
	TCP-LBF-IA1.36.IE.1	Surge Protector for Plugging onto the Trunk, Ex ia with Integrated Diagnostics
	SCP-LBF-IA1.36.IE*	Fieldbus Surge Protector, Field Installation on Spur
	SCP-LBF-IA1.36.IE.0	Surge Protector, Pluggable onto the device coupler for the Spur, Ex ia
	SCP-LBF-IA1.36.IE.1	Surge Protector, Pluggable onto the device coupler for the Spur, Ex ia with Integrated Diagnostics
	ACC-LBF-EB.6	6x Grounding Rail for Surge Protection, SCP-LBF*, R2-SP*, and R4D0-FB*
	ACC-LBF-SW.3	Separation Wall for Installation on the Surge Protector TCP-LBF*, 3 pcs., Ex ic Applications
	ACC-R2-SW.3	Separation Wall for Ex ic Applications

Additional Information

Dimensions and Assembly

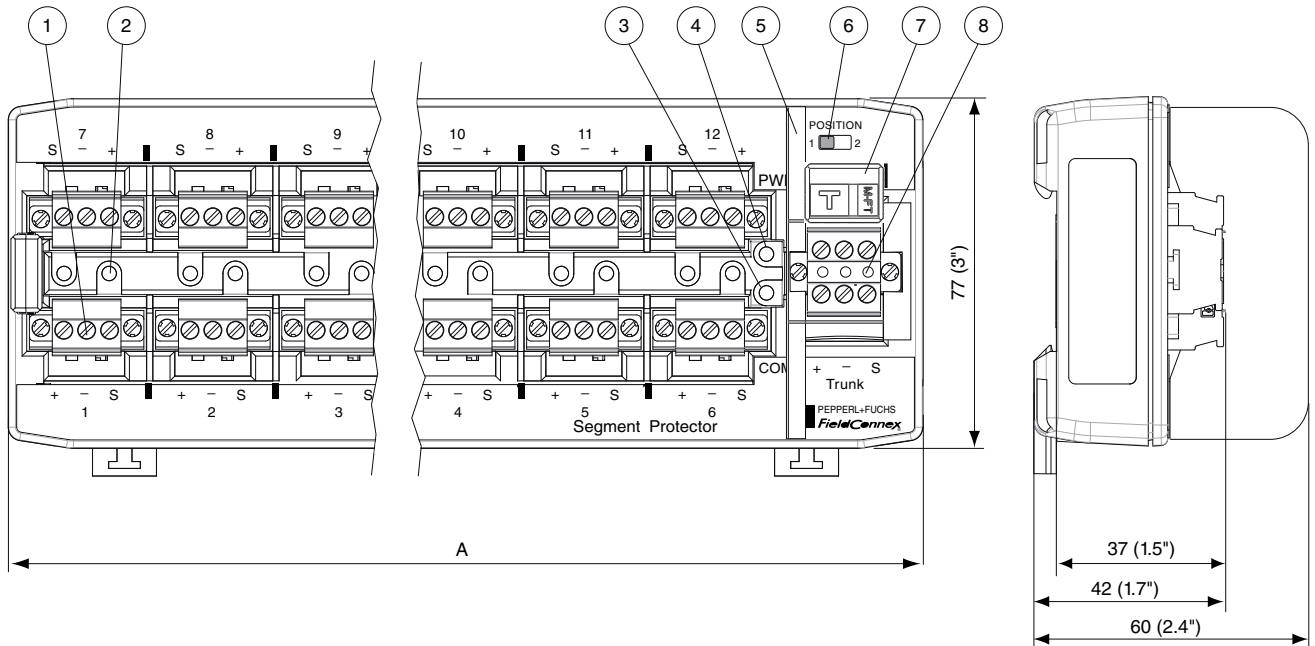

All dimensions in millimeters (mm) and inches (") and without tolerance indication.

Description:

- 1 Connection spur 1
- 2 LED ERR spur 1 (red, short circuit)
- 3 LED COM/ERR (communication/diagnostics)
- 4 LED PWR (power)
- 5 Separation wall ACC-R2-SW.3
- 6 Switch, short circuit current selection
- 7 Terminator M-FT, removable
- 8 T-connector T-CON.3

Housing height "A" see table "Technical data depending on model".

Installation

see manual

Electrical Connection

Table 1: Technical data depending on model

	R2-SP-IC4*	R2-SP-IC6*	R2-SP-IC8*	R2-SP-IC10*	R2-SP-IC12*
Number of outputs	4	6	8	10	12
Housing height (A)	93 mm (3.7")	121 mm (4.7")	148 mm (5.8")	177 mm (7")	205 mm (8")
Mass	130 g	180 g	230 g	280 g	330 g
Quiescent current	max. 15 mA	max. 17 mA	max. 17 mA	max. 19 mA	max. 19 mA
Power loss at 31 V input	470 mW**	530 mW**	530 mW**	590 mW**	590 mW**

** + 10 mW per spur at 20 mA load

Table 2: Wire cross section


Wire cross section		Trunk terminals	Spur terminals
Screw terminal	flexible wire	0.2-2.5 mm ²	0.2-2.5 mm ²
	rigid wire	0.2-2.5 mm ²	0.2-2.5 mm ²

Release date: 2023-08-01 Date of issue: 2023-08-01 Filename: t1158642_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Spring terminal	flexible wire	0.5-2.5 mm ²	0.2-2.5 mm ²
	rigid wire	0.5-2.5 mm ²	0.2-2.5 mm ²

Type Code

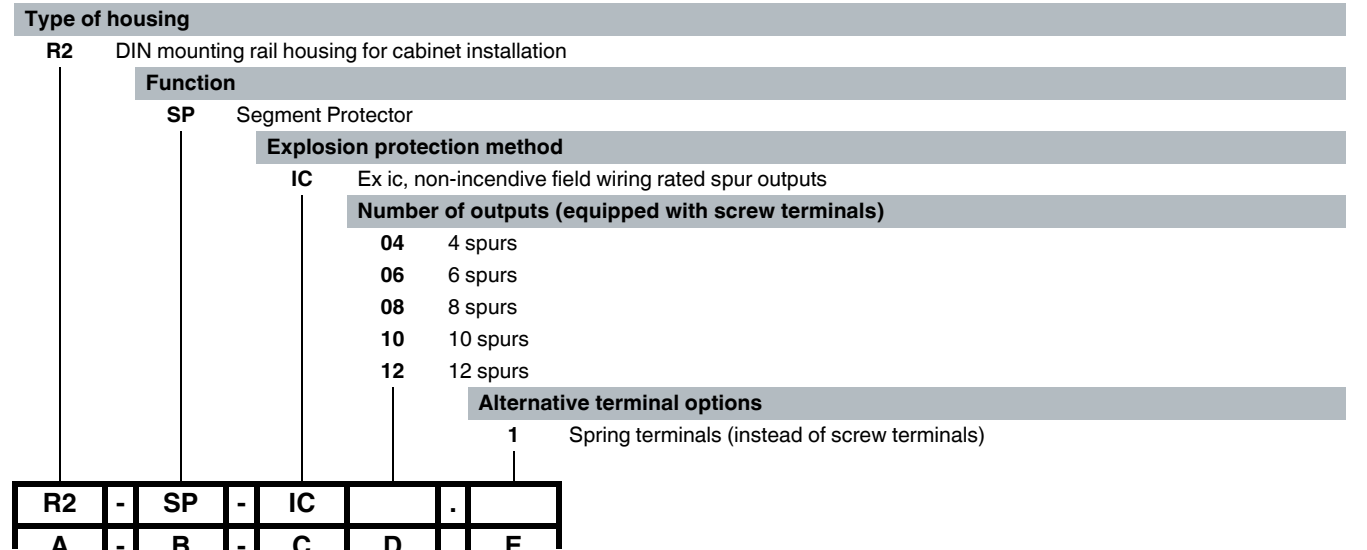

Delivery

Scope of Delivery

Type code	Description
1 x M-FT	Fieldbus Terminator
1 x T-CON.3	T-Connector
1 x TP-CON.3 per output	Fieldbus plug sockets with test points

Release date: 2023-08-01 Date of issue: 2023-08-01 Filename: t158642_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".